

How Does Two-Stage Expansion Affect Efficiency of a Gas Turbine?



Lucas Kuhns¹ and Dr. Mounir Ibrahim²
¹ Mechanical Engineering, Cleveland State University, Cleveland Ohio
² Chairman Mechanical Engineering Department, Cleveland State University



Introduction: Today the world demands more energy than ever before. Because of the economic and environmental costs of electricity production, it is important that the most efficient methods are used. This project seeks to compare the gains in thermal efficiency of a 350 MW gas turbine by adding two-stage expansion. Both designs will have the same compressor inlet conditions, the same maximum temperature, and will both use regeneration.

Background Information:

The Brayton cycle is a thermodynamic cycle used in gas turbines such as those in aircraft or a natural gas power plant. Air is compressed then passes through a combustion chamber where it is heated. These hot, gases at very high pressure and temperature, then pass through a turbine which produces shaft work. In a power plant, this shaft work is used to power a generator and produce electricity.

As with all thermodynamic cycles, the process can be plotted on a temperature-entropy diagram. The enclosed area of the plot represents the net power output of the cycle per kilogram of air passing through the turbine. The numbers on the flow diagram correspond to the state on temperature entropy diagram.

Governing Equations:



Compressor Power = (Mass Flow Rate) X (Enthalpy Difference)

Turbine Power = (Mass Flow Rate) X (Enthalpy Difference)

Net Power Output = Turbine Power - Compressor Power

Cycle Efficiency = Net Power Output / Heat Input

Comparison of Temperature-Entropy Diagrams:

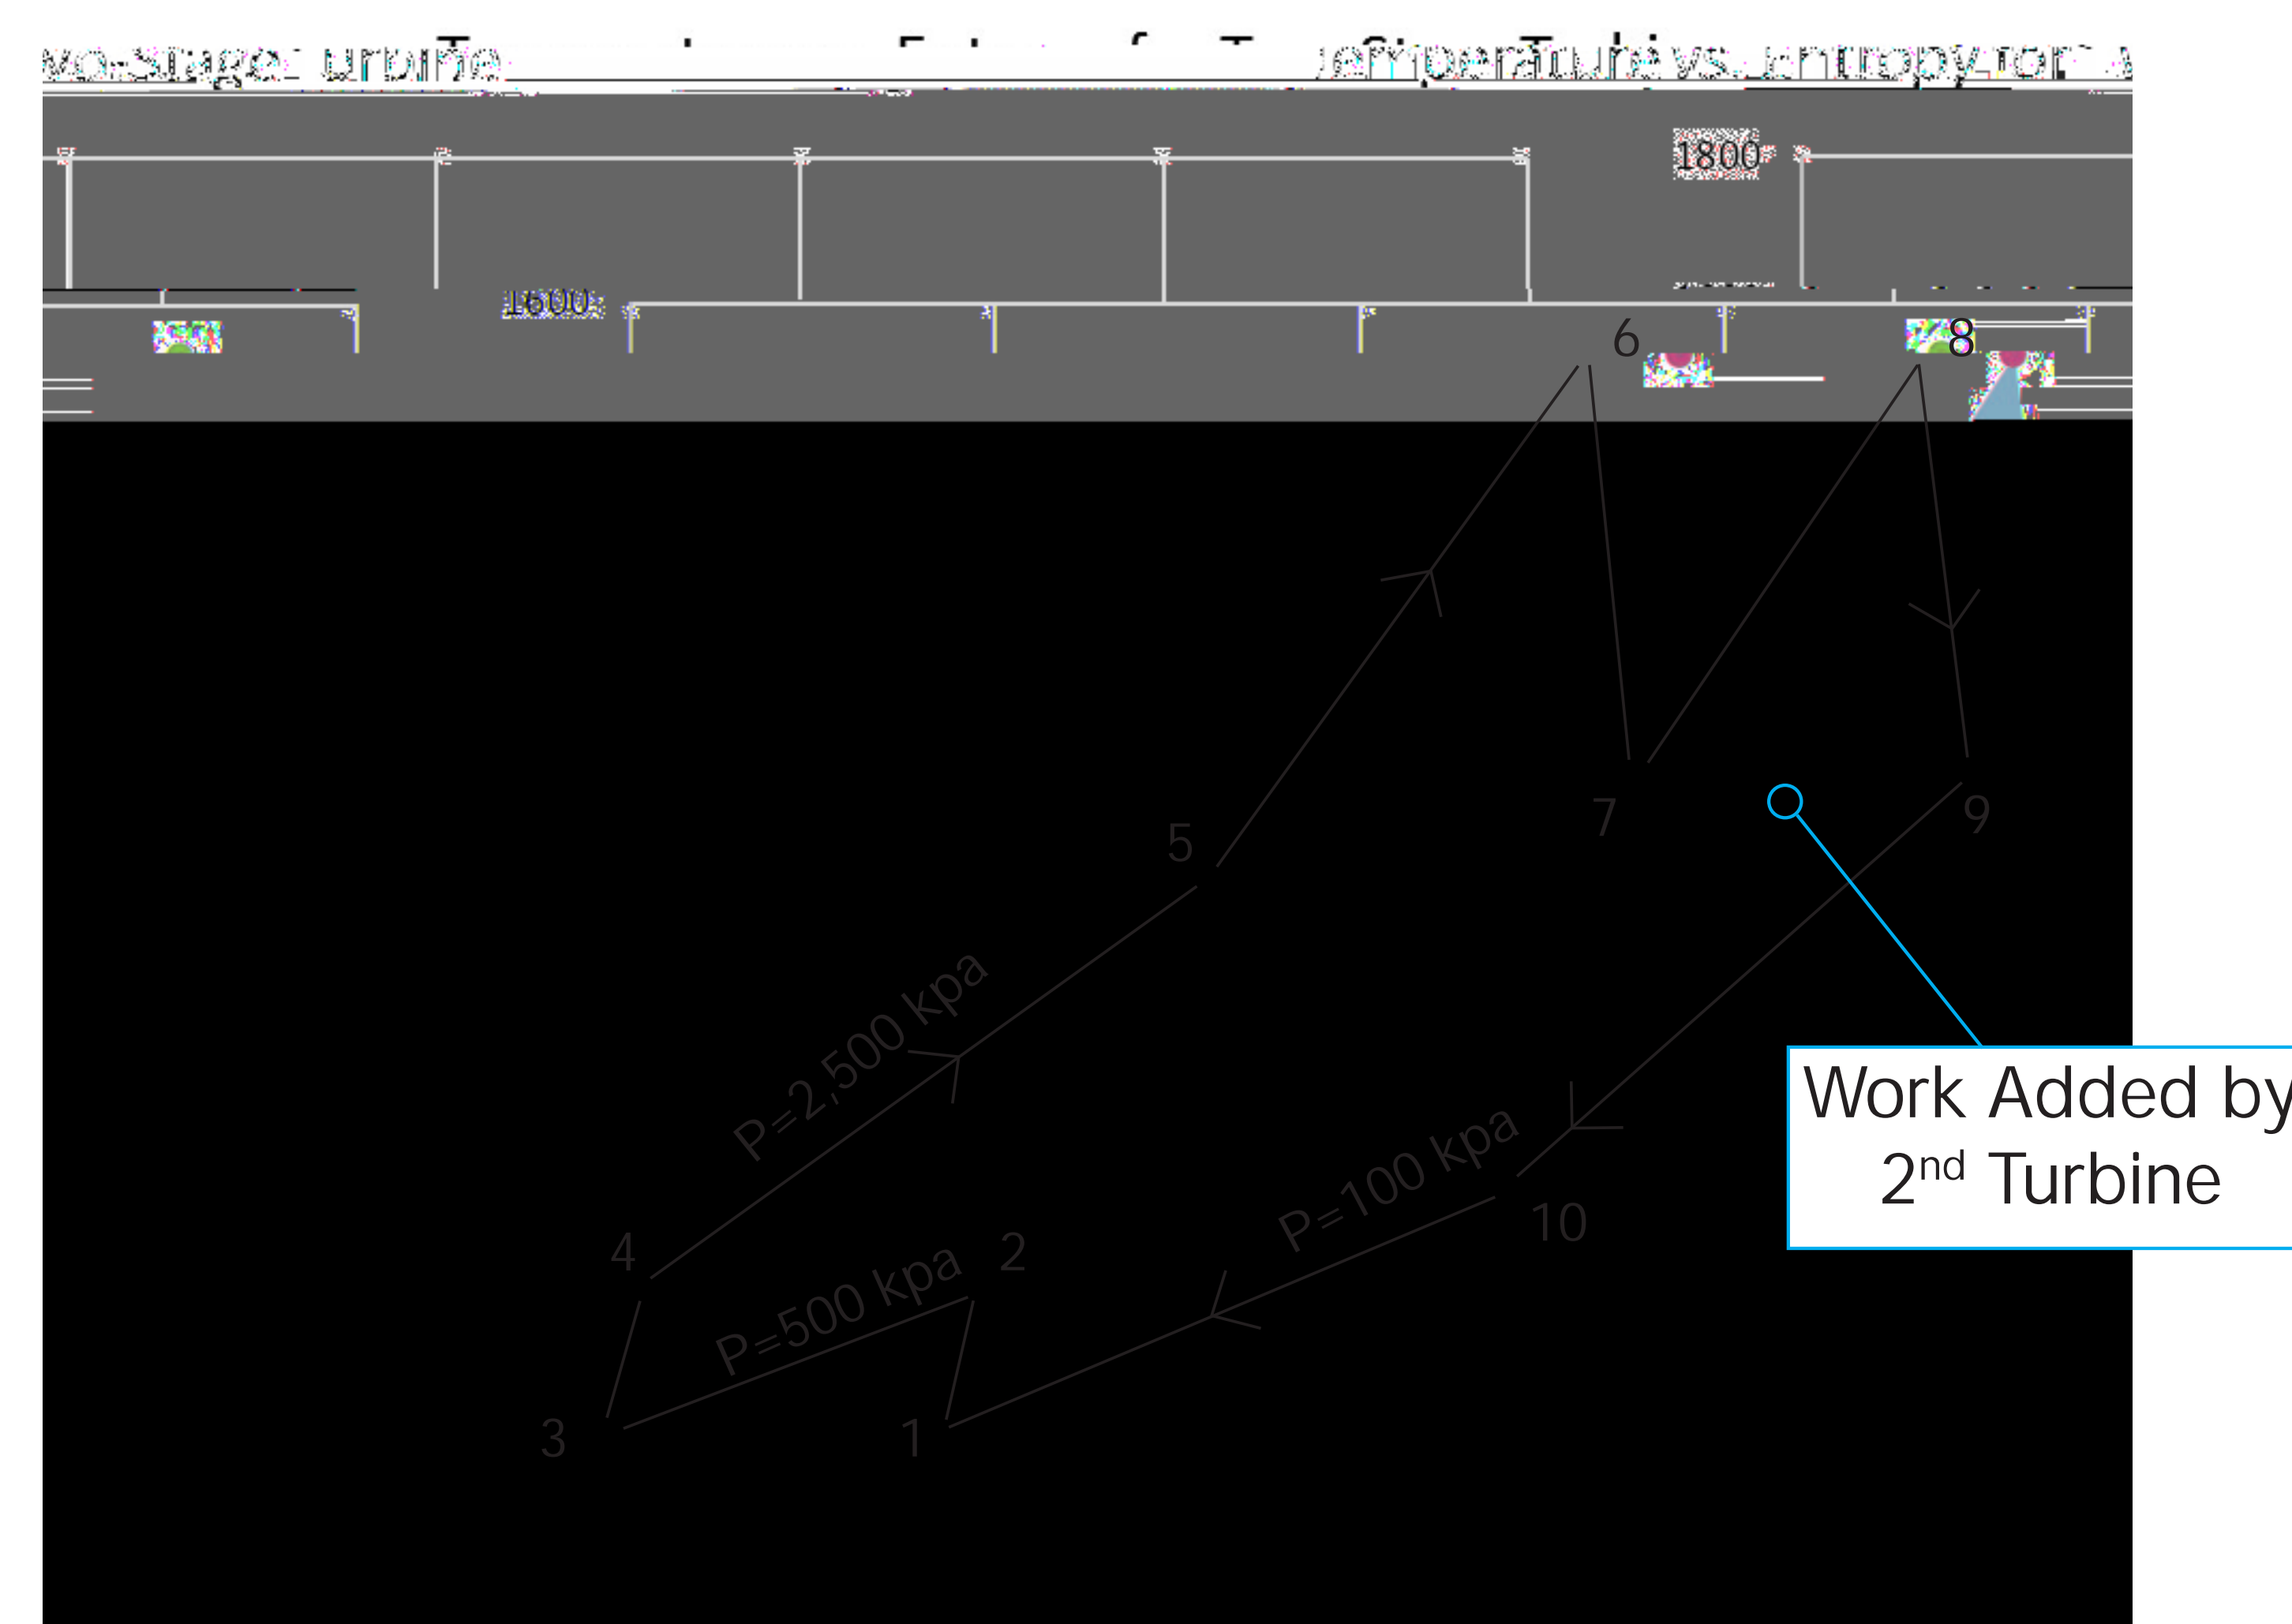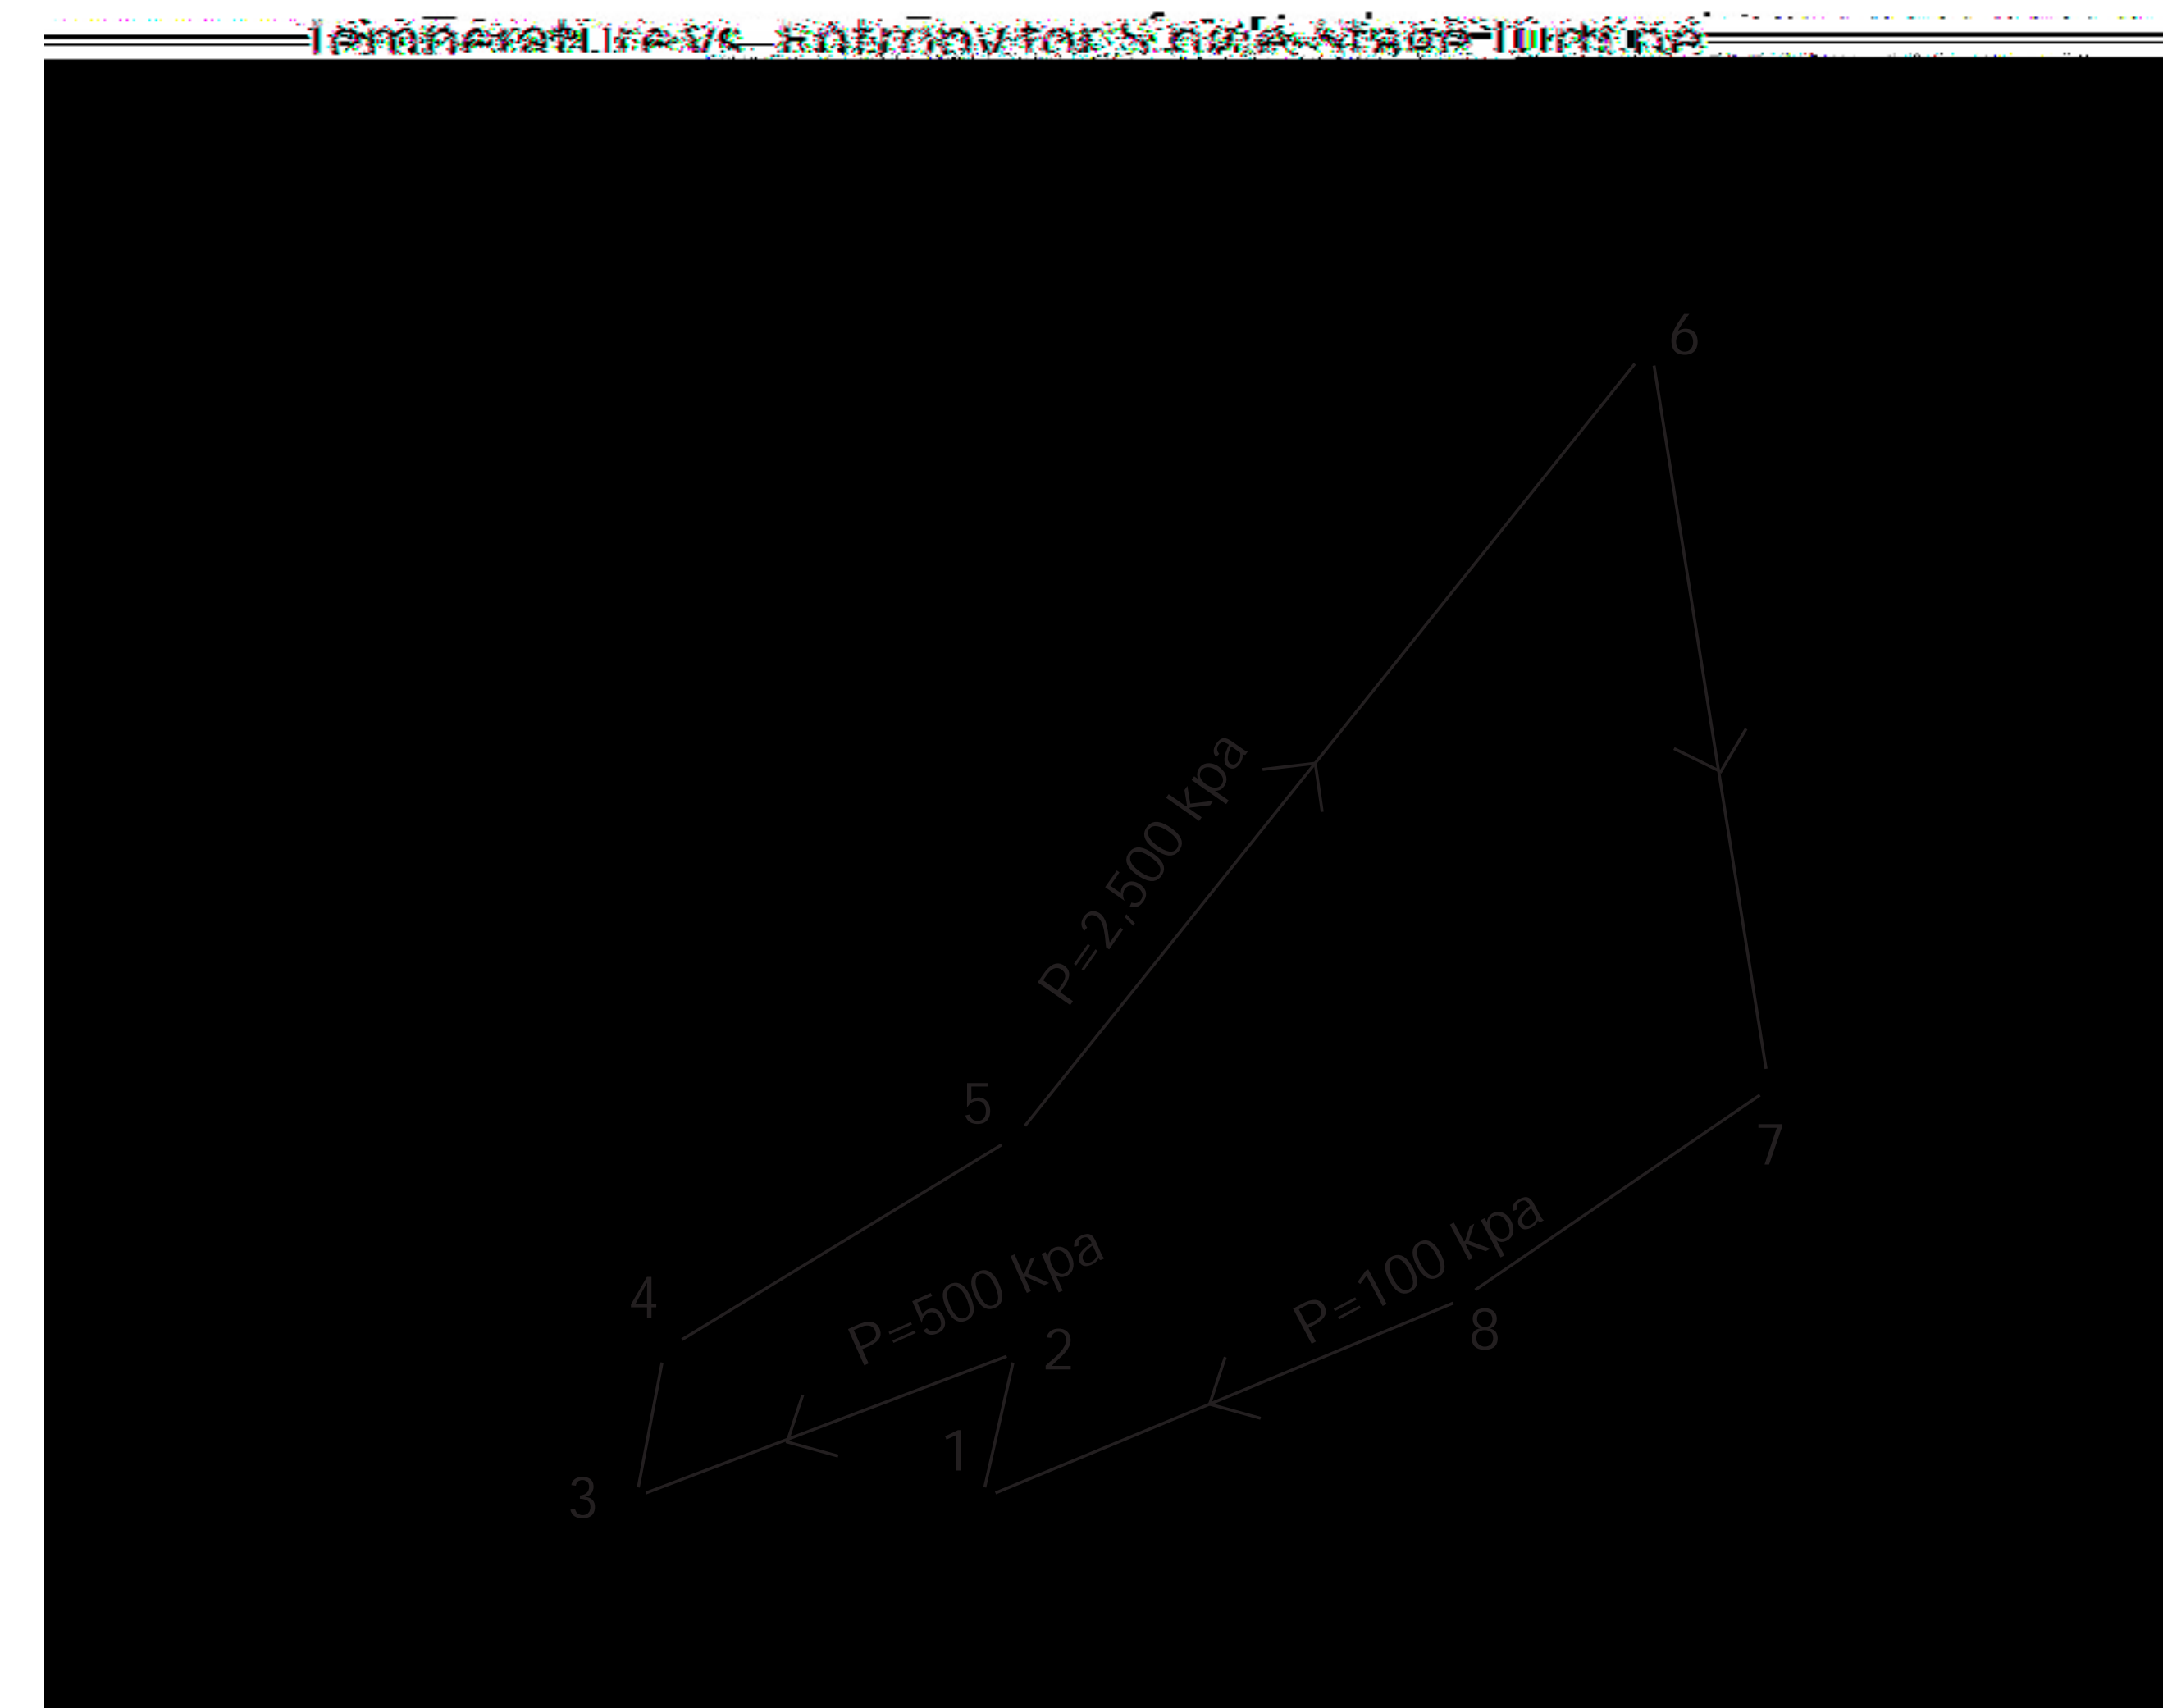

Observations:

- Adding the second turbine increases thermal efficiency by 5% .
- Although the heat input per kilogram is higher with two turbines (+28%), the net work increases by a greater percentage (+39%) which increases the overall efficiency.

Conclusion:

When using regeneration, the overall efficiency of the Brayton Cycle can be improved by also adding a second turbine. In this analysis, the heat addition required to get 350 MW of power is reduced by 7% when using a second turbine. This reduction in heat requirement will